

DEVELOPER/CONTRACTOR NOTES:

DEVELOPER/CONTRACTOR SHALL PROVIDE 12' UTILITY EASEMENT FOR OHIO EDISON TO INSTALL FACILITIES.

DEVELOPER/CONTRACTOR SHALL PROVIDE ALL TRENCHING (MIN 12' WIDE, 42" DEEP), BACKFILL, RESTORATION AND FINAL GRADE COVER PER OHIO EDISON SPECIFICATIONS.


DEVELOPER/CONTRACTOR SHALL PROVIDE AND INSTALL CONDUIT PER OHIO EDISON SPECIFICATIONS (MIN 4" DIAMETER WITH PULL STRING).

OHIO EDISON TO INSTALL:

- * 2 - 25KVA, 7.2KV, 120/240V XFMR'S
- * 2 - 50KVA, 7.2KV, 120/240V XFMR
- * 10 - HDPE HHs 17 X 30 X 17

APPROX. 2800' - #2 ALLCN URD PRIMARY

APPROX. 1215' - 350 AL URD TPX

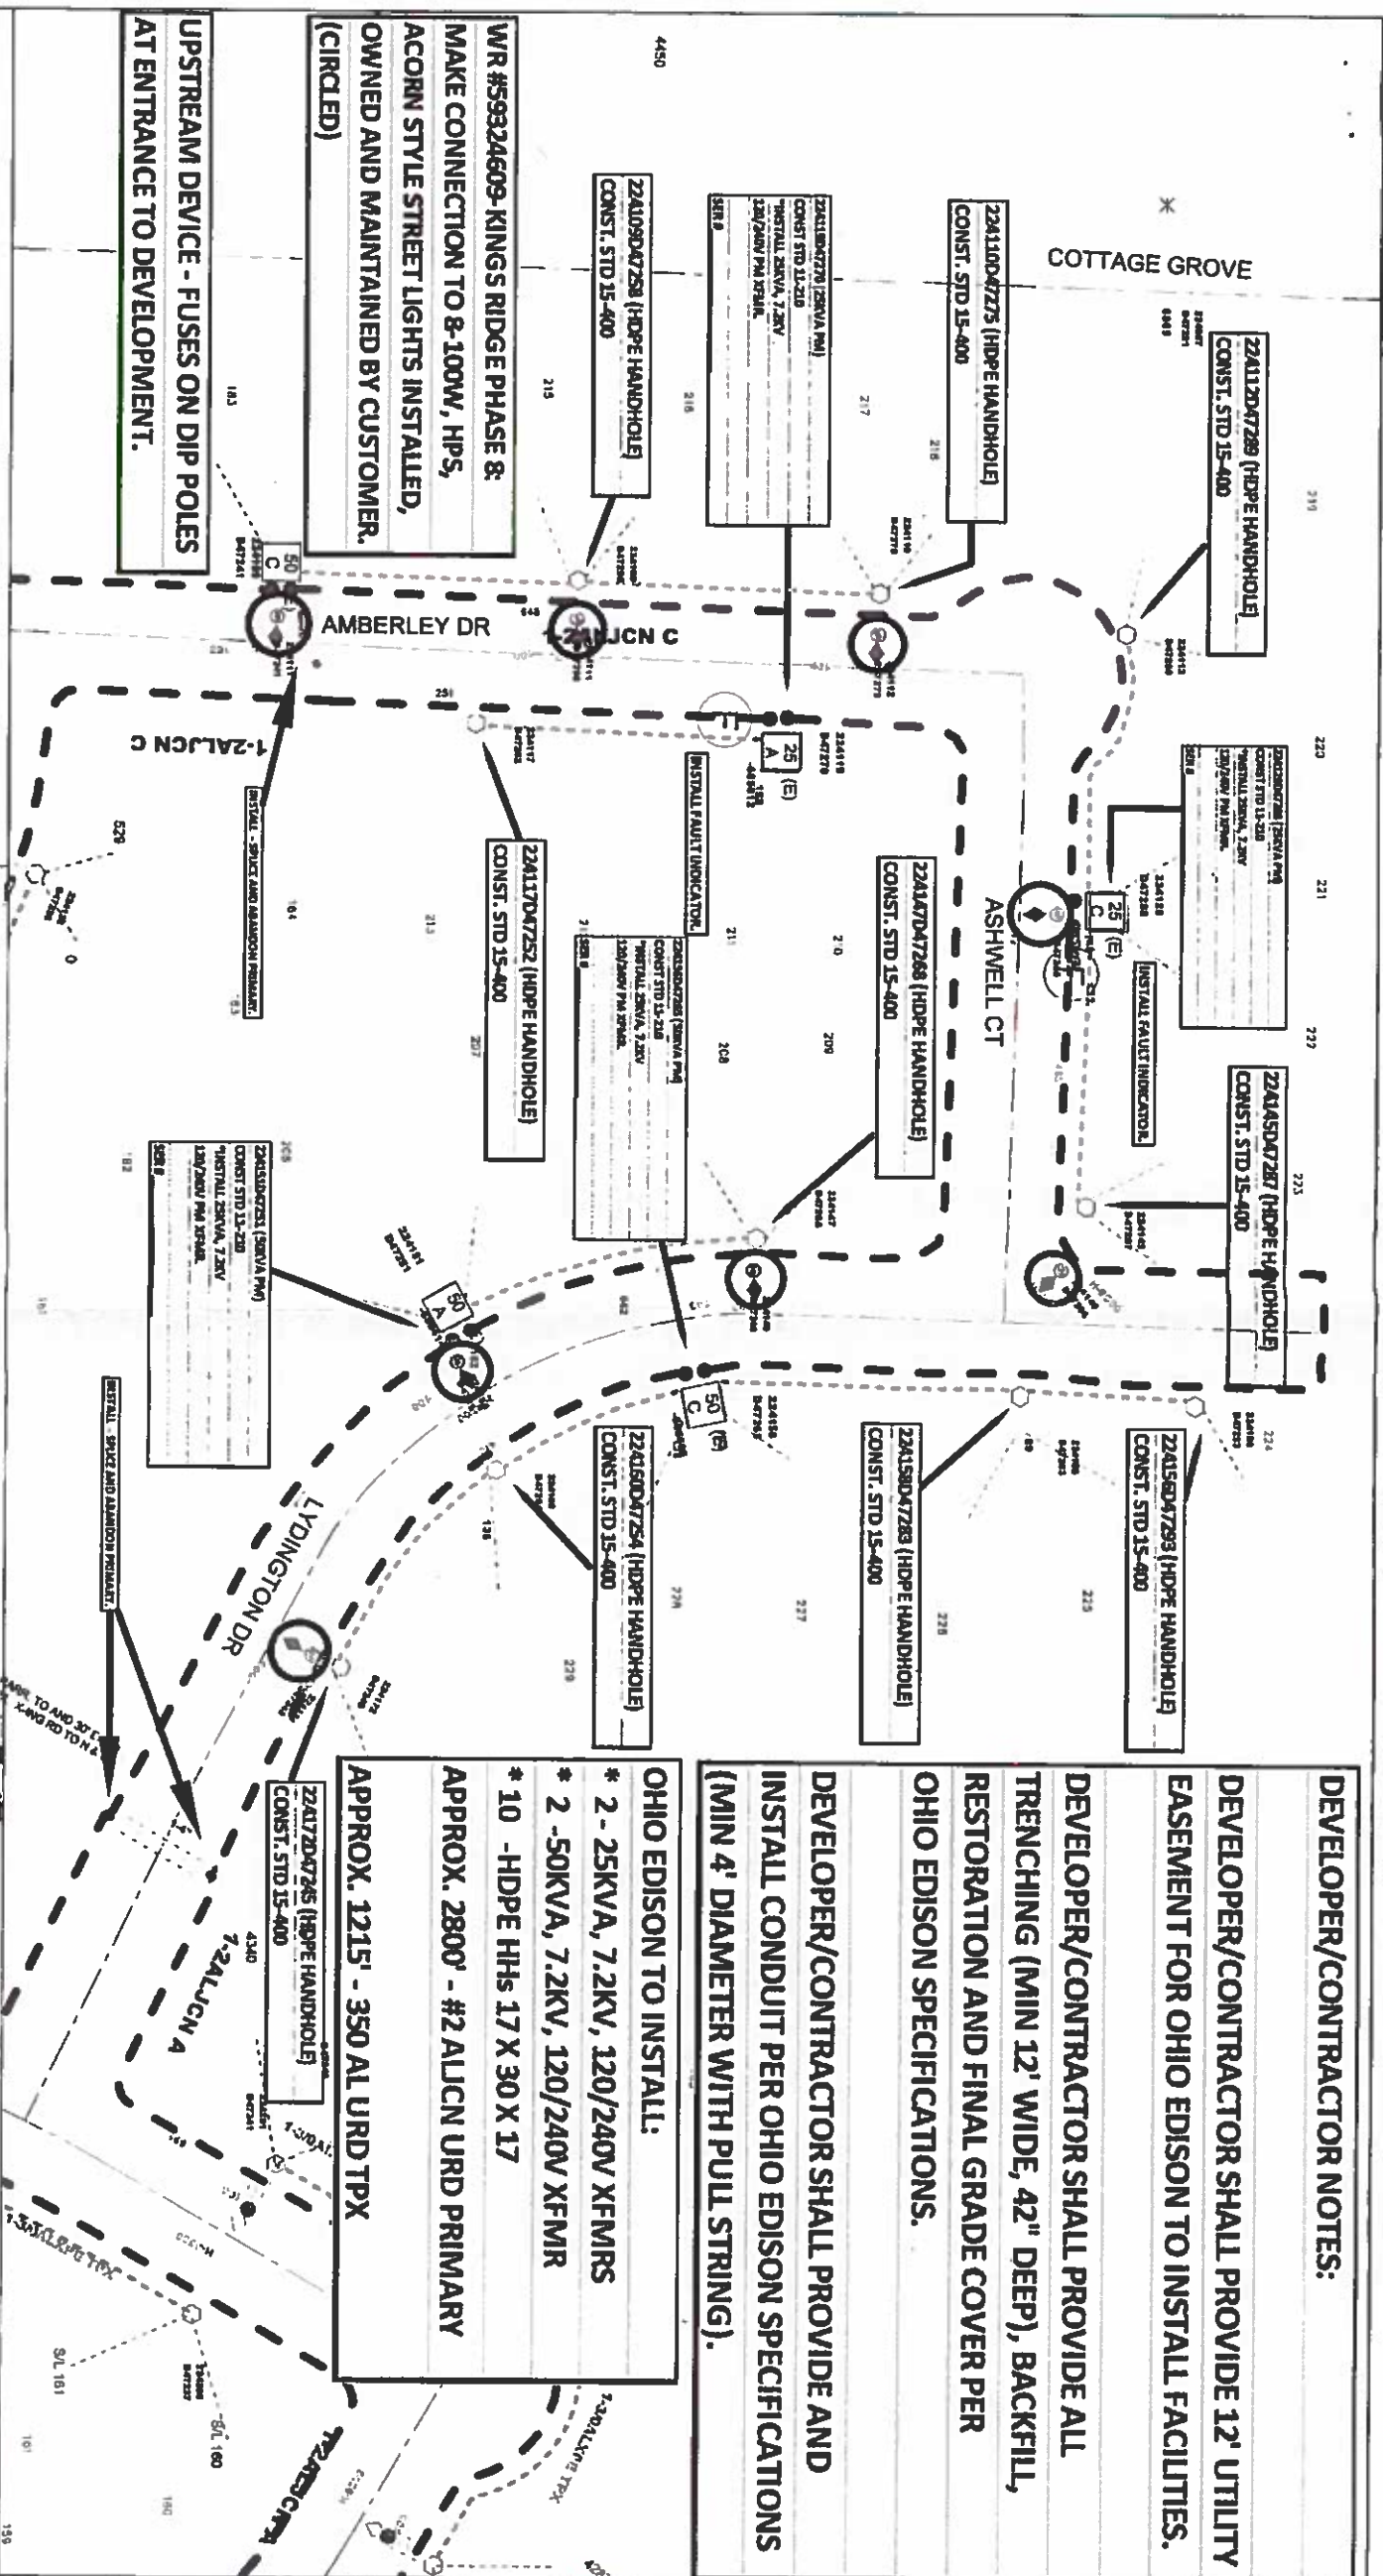

WR #59324609-KINGS RIDGE PHASE 8:
MAKE CONNECTION TO 8-100W, HPS,
ACORN STYLE STREET LIGHTS INSTALLED,
OWNED AND MAINTAINED BY CUSTOMER.
(CIRCLED)

UPSTREAM DEVICE - FUSES ON DIP POLES
AT ENTRANCE TO DEVELOPMENT.

Designer : LEWIS, SHARON A	Phone : (330) 436-4067	WR Name : 59123180	Substation : NIMISILA	Circuit : CASTON
Sales Rep : LEWIS, SHARON A	Phone : (330) 436-4067	Township - County : -----	Tox District : A3	
Scheduler : CLABAUGH, NICHOLAS J	Phone : (330) 436-4143 ext.	Customer/Elect Name : -----	Customer/Elect Phone : -----	
Work Request : 59123180	SAP Order # : 15603593	Customer: KINGS RIDGE OF SUMMIT CNTY,	Phone: (330) 806-4510	
Apprv: _____	Date: _____	Apprv: _____	Date: _____	
Proposal : [Y or N] #s:] N	City : AKRON	Street No : -----	Street Name : AMBERLEY DR	
		Zip : 44319	Foreman's Signature: _____	Cont. Comp. Date: _____

Received

APR 16 2018